



**NOTES:**

1. All reinforcing steel shall be Grade 500MPa in accordance with AS/NZS 4671.2011.
2. All blockwork shall be Grade B construction in accordance with NZS 4210.2011.


**5-5 CROSS-SECTION**  
Scale: N.T.S

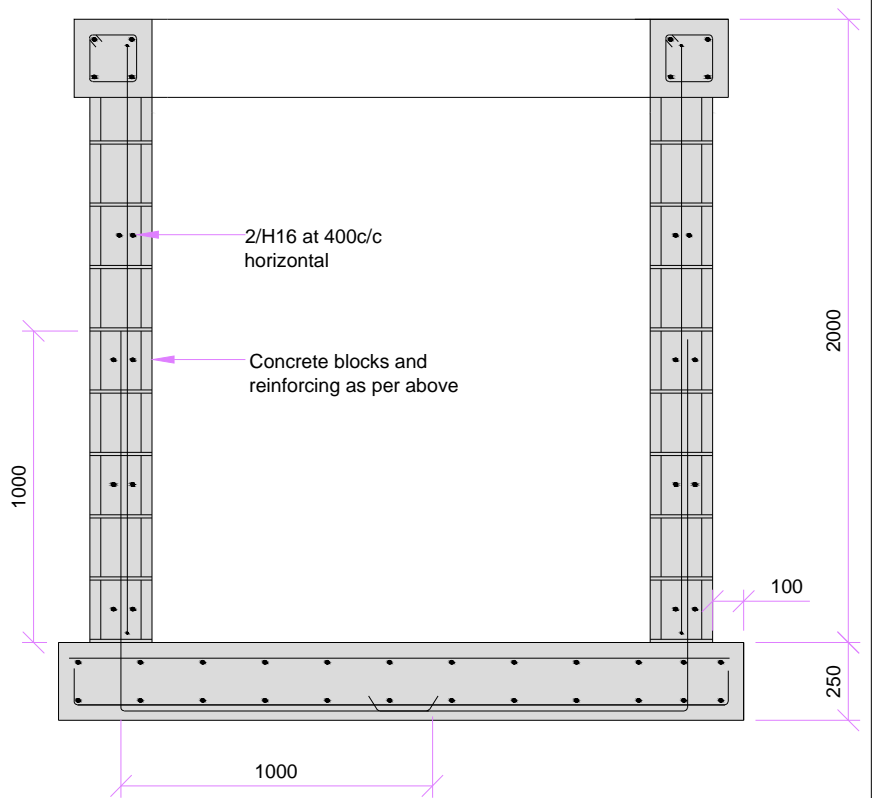


**6-6 CROSS-SECTION**  
Scale: N.T.S

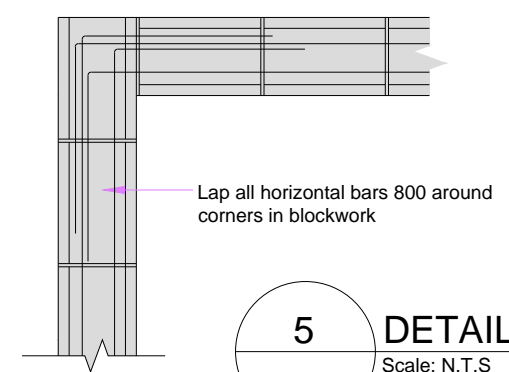

**5 DETAILS**  
Scale: N.T.S

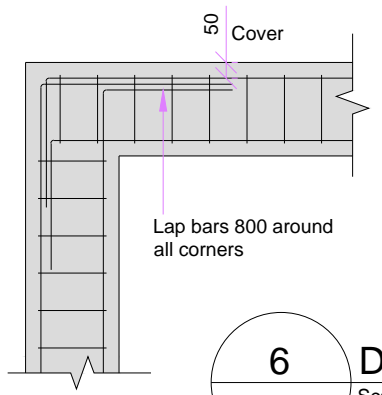

**6 DETAILS**  
Scale: N.T.S

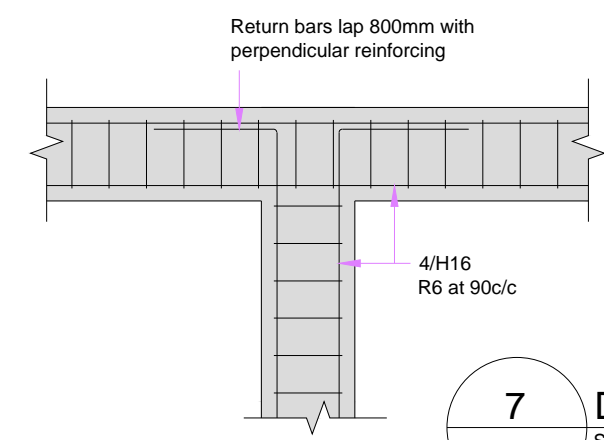

**7 DETAILS**  
Scale: N.T.S

	BY:	DATE	REV.	DESCRIPTIONS	DATE	APPROVED
DESIGNED :	--	--/--/----			--/--/----	--
DRAWN :	--	--/--/----			--/--/----	--
DSGN CHECKED :	--	--/--/----			--/--/----	--
DWG CHECKED :	--	--/--/----			--/--/----	--
APPROVED :	--	--/--/----			--/--/----	--

DRAWING TITLE : **PRV CHAMBER CROSS - SECTIONS  
NO VEHICLE LOAD**

PROJECT TITLE : **STANDARD DRAWING**

**SAMOA WATER AUTHORITY**  
Level 2 TATTE Building  
Apia, Sogi  
Ph: +685 20409  
Fax: +685 21298



SIZE	CONTRACT NUMBER :	REVISION
A3		
SCALE :	DRAWING NUMBER :	
N.T.S	W - 009 (b)	