


CROSS SECTION A-A: BREAK PRESSURE TANK
N.T.S

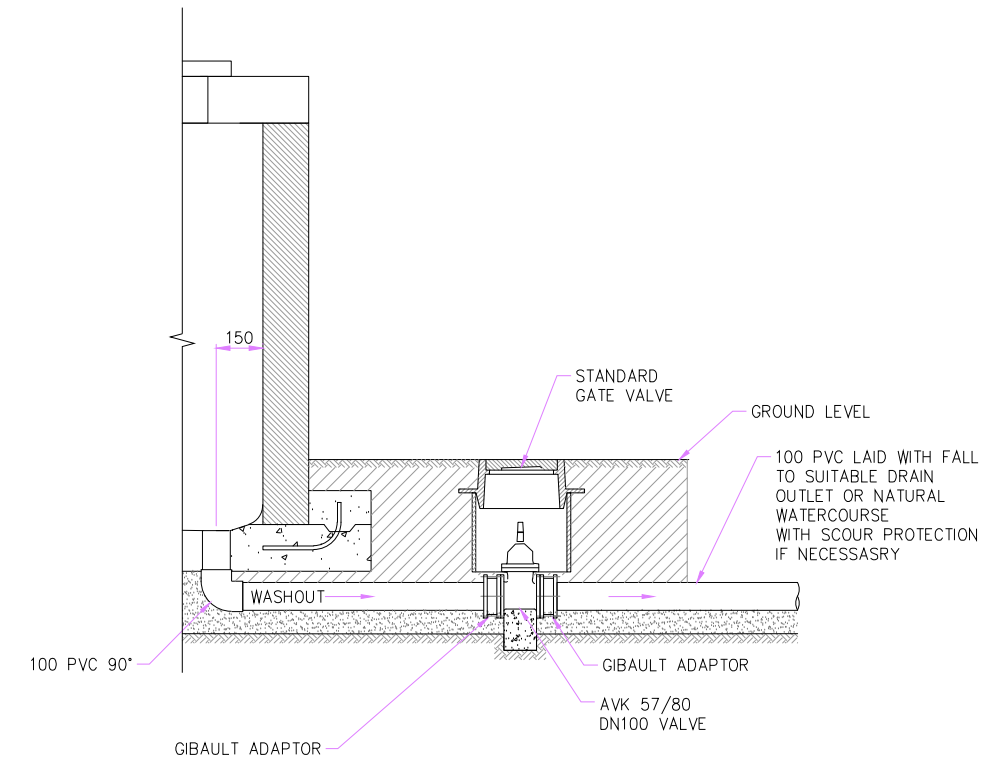


CROSS SECTION B-B: WASHOUT
N.T.S

GENERAL NOTES:


1. ALL PVC PIPES THROUGH CONCRETE WALLS SHALL HAVE SAND GLUED TO THE OUTSIDE OF THE PIPE WITH SOLVENT CEMENT.
2. ALL PVC PIPE TO BE PRESSURE PIPE TO AS/NZ 1477
3. BEDDING MATERIAL SHALL BE AP40 HARDFILL BEDDING

INSTALLATION NOTES:


1. EXCAVATE, LAY PIPE AND REINFORCEMENT
2. POUR CONCRETE BASE
3. PLACE KING CONSTRUCTION PIPE AND POUR RING BEAM
4. INSTALL CONCRETE LID AND HATCH

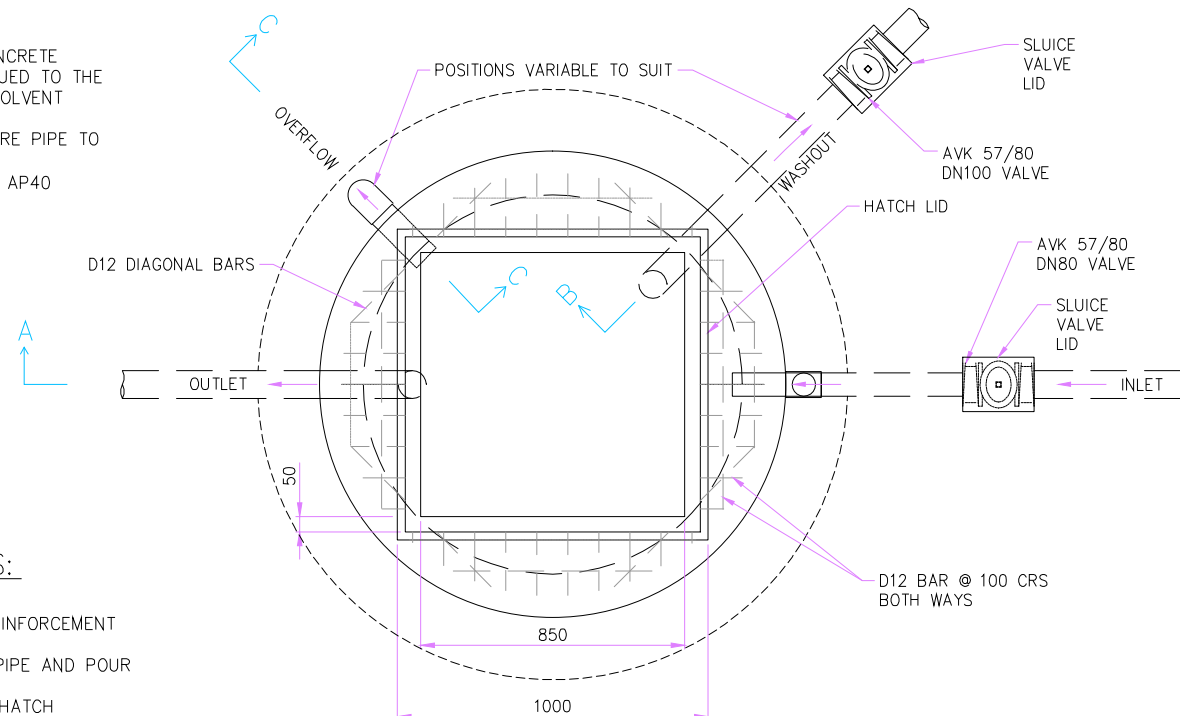

PLAN: BREAK PRESSURE TANK
N.T.S

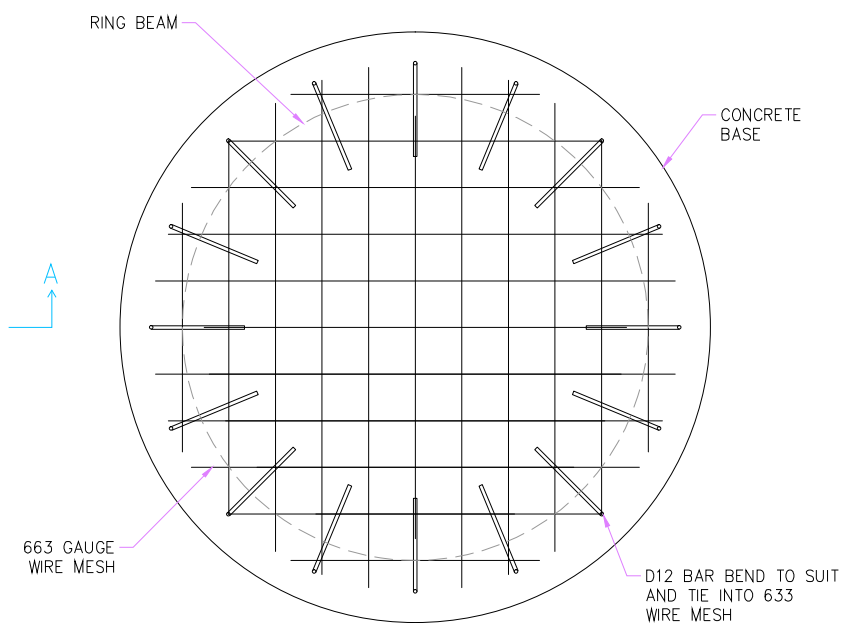

CROSS SECTION D-D: BASE
N.T.S

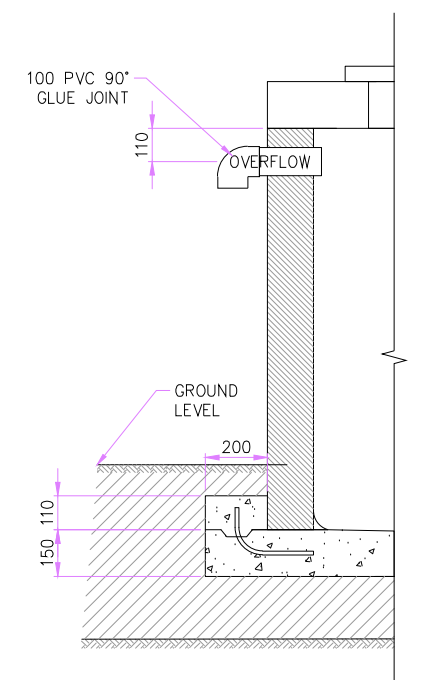

CROSS SECTION C-C: OVERFLOW
N.T.S

	BY:	DATE	REV	DESCRIPTIONS	DATE	APPROV
DESIGNED :	--/..../..		/..../..	--
DRAWN :	--/..../..		/..../..	--
DSGN CHECKED :	--/..../..		/..../..	--
DWG CHECKED :	--/..../..		/..../..	--
APPROVED :	--/..../..		/..../..	--

DRAWING TITLE:
BREAK PRESSURE TANK TYPICAL DETAIL

PROJECT TITLE:
STANDARD DRAWING

SAMOA WATER AUTHORITY
Level 2 TATTE Building Apia, Samoa Ph: +685 20409 Fax: +685 21298


SIZE	CONTRACT NUMBER:	REVISION
A3		0
SCALE:	DRAWING NUMBER:	
N.T.S	W - 023	